


# Ignition Control Modules - Sequence of Operation

The Sequence of Operation depicted below represents Intermittent Ignition Device (IID).  
Ignition Modules are available as DSI, IID, or HSI

## NORMAL OPERATION

## ABNORMAL OPERATION

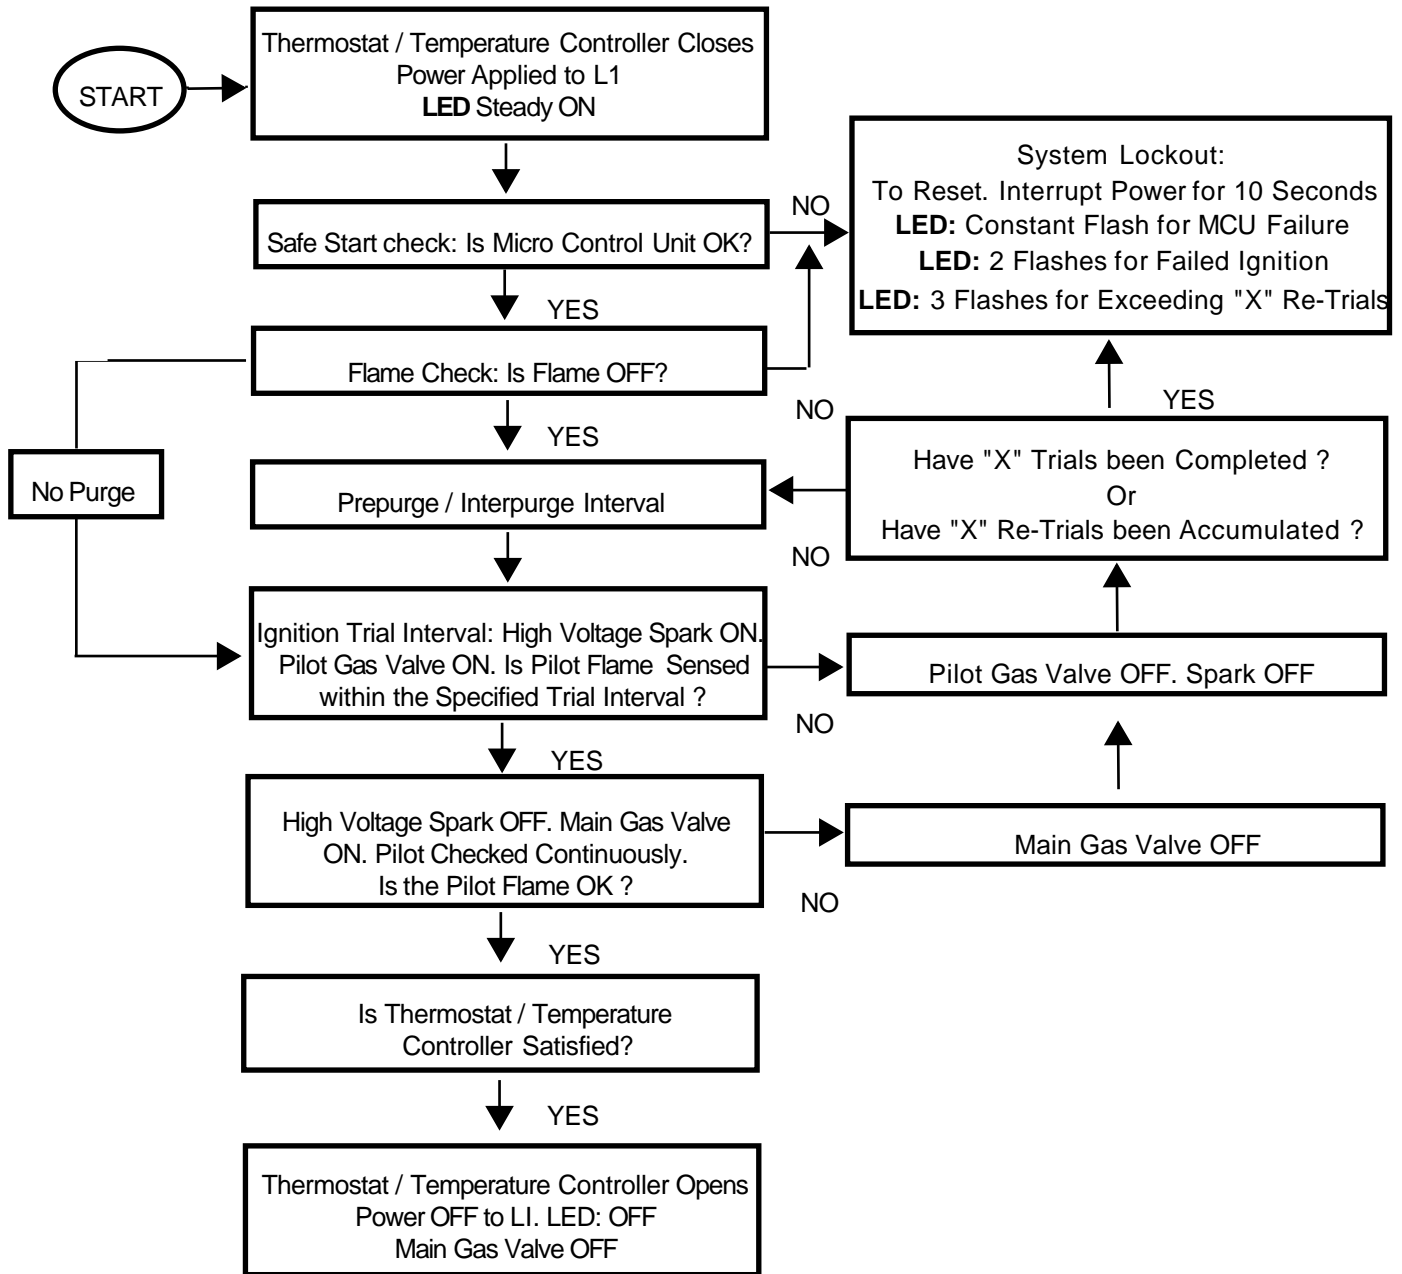

CAUTION: Operation of combustion equipment can be hazardous resulting in bodily injury or equipment damage. Each burner should be supervised by a combustion safeguard and only qualified personnel should install, make system adjustments and perform any required service.



**ORDAN THERMAL PRODUCTS LTD**  
 Combustion Equipment & Controls for Industry  
 21 Amber St # 9, Markham Ontario Canada L3R 4Z3  
 Tel: (905) 475-9292 Fax: (905) 475-3286  
[www.ordanthermal.com](http://www.ordanthermal.com)

NOTICE : ORDAN practices a policy of continuous improvement in the design of its products. It reserves the right to change the specifications at any time without prior notice.