

# REGULATORS FLOW CONTROL

MODEL: 5105 - FCR  
5105 - FCR - PC

Revision: 0

BULLETIN  
5105

## DESCRIPTION

**FCR - Flow Control Regulators** are double diaphragm spring balanced flow ratio control regulators that offer maximum control and fuel efficiency on gas-fired applications involving preheated air to the burners, or where burners fire against a varying back pressure.

The FCR monitors air mass flow by means of a pressure differential across a POP Orifice Flow Meter (Bulletin 5720). The signal from the POP is applied across the regulator large top diaphragm; pressure differential automatically compensates for back pressure. Lower matching "gas" diaphragm is connected to suit the application. Three smaller diaphragms are used within the regulator to balance out dynamic and static forces in the control system.

The FCR holds a constant air/fuel ratio from cold start-up through hot air application. All control components are on the cold side of the system and are unaffected by high combustion air temperatures, minimizing cost and maintenance and permitting initial start-up adjustment to be made on cold air at the high fire condition and adjusting gas to the desired ratio.

On oil or dual fuel applications, use a 6 PCR Pilot Control Regulator (Bulletin 5107).



## FEATURES

- Operating temperatures to 150 °F
- Maximum inlet pressure: 2 psig
- Maximum air signal: 15" W.C.
- Nominal air signal: 10" W.C.
- Minimum air signal: 0.1" W.C.
- Accuracy:
  - Low Flow: + 0.0 / - .04" W.C.
  - Full Flow: + 0.0 / - 0.4" W.C.
- Turndown: up to 10:1
- All units factory tested and sealed before shipment.

## CAPACITY TABLE

Model Number	Pipe Size NPT	SCFH Gas Flow @ 4.0" W.C. Pressure Drop				
		Mfd. Gas	Nat. Gas	Air	Propane	Butane
		0.4 Sp. Gr.	0.6 Sp. Gr.	1.0 Sp. Gr.	1.5 Sp. Gr.	2.0 Sp. Gr.
6 FCR	3/4"	735	600	465	380	330
8 FCR	1"	1,475	1,205	930	760	660

## APPLICATIONS

- Hot air burner systems: cover annealing furnaces - reheat furnaces - continuous kilns - glass tanks - etc.
- Varying back pressure systems: paper drying - atmosphere generators - periodic kilns - forced air dryers - lumber kilns

**CAUTION:** Operation of combustion equipment can be hazardous resulting in bodily injury or equipment damage. Each burner should be supervised by a combustion safeguard and only qualified personnel should install, make system adjustments and perform any required service.



**pyronics inc.**

COMBUSTION FOR INDUSTRY

17700 MILES ROAD  
CLEVELAND, OH 44128  
www.pyronics.com


Tel: 216-662-8800  
Fax: 216-663-8954  
marketing@pyronics.com

**NOTICE:** PYRONICS practices a policy of continuous improvement in the design of its products. It reserves the right to change the specifications at any time without prior notice.


# REGULATORS FLOW CONTROL

BULLETIN 5105  
PAGE NO.2

## DIMENSIONS

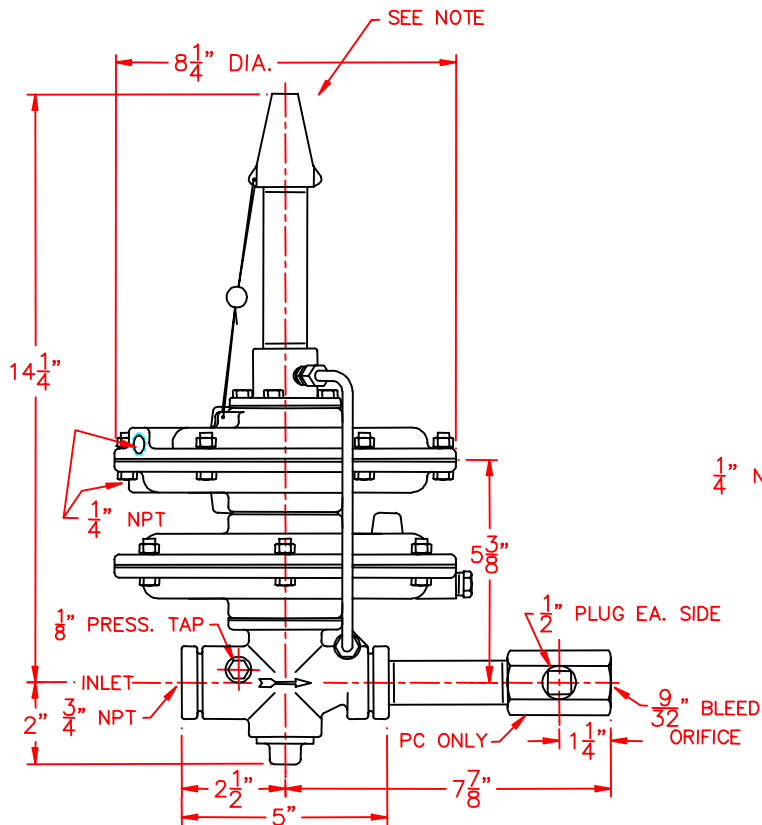

6FCR (10 LBS)  
6FCR-PC (11 LBS)


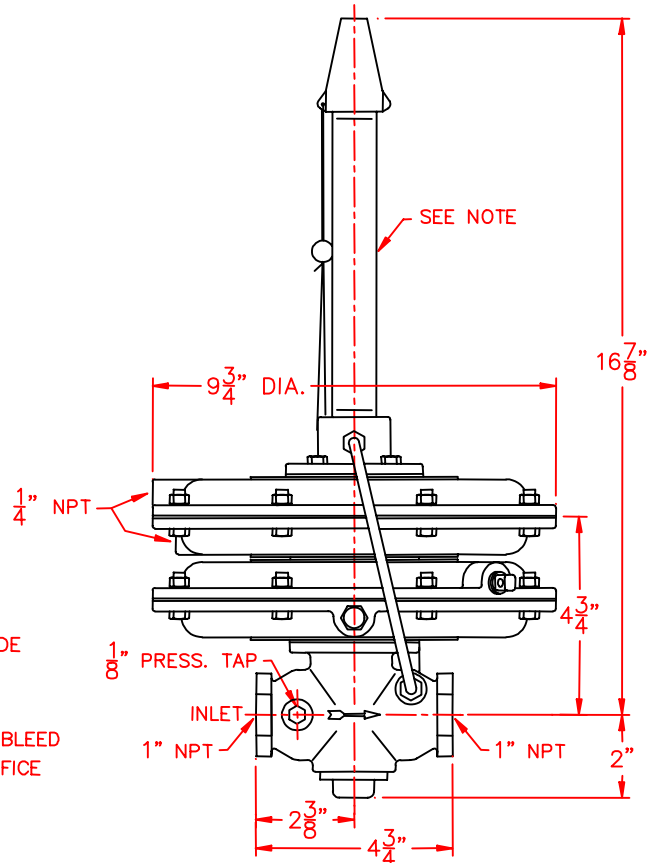


8FCR (14.8 LBS)

NOTE : SPRING HOUSING MUST BE PERPENDICULAR TO PIPE RUN IN AN UPRIGHT POSITION.  
GAS PIPE RUN MUST BE HORIZONTAL AND LEVEL.

# REGULATORS FLOW CONTROL

BULLETIN 5105  
PAGE NO. 3

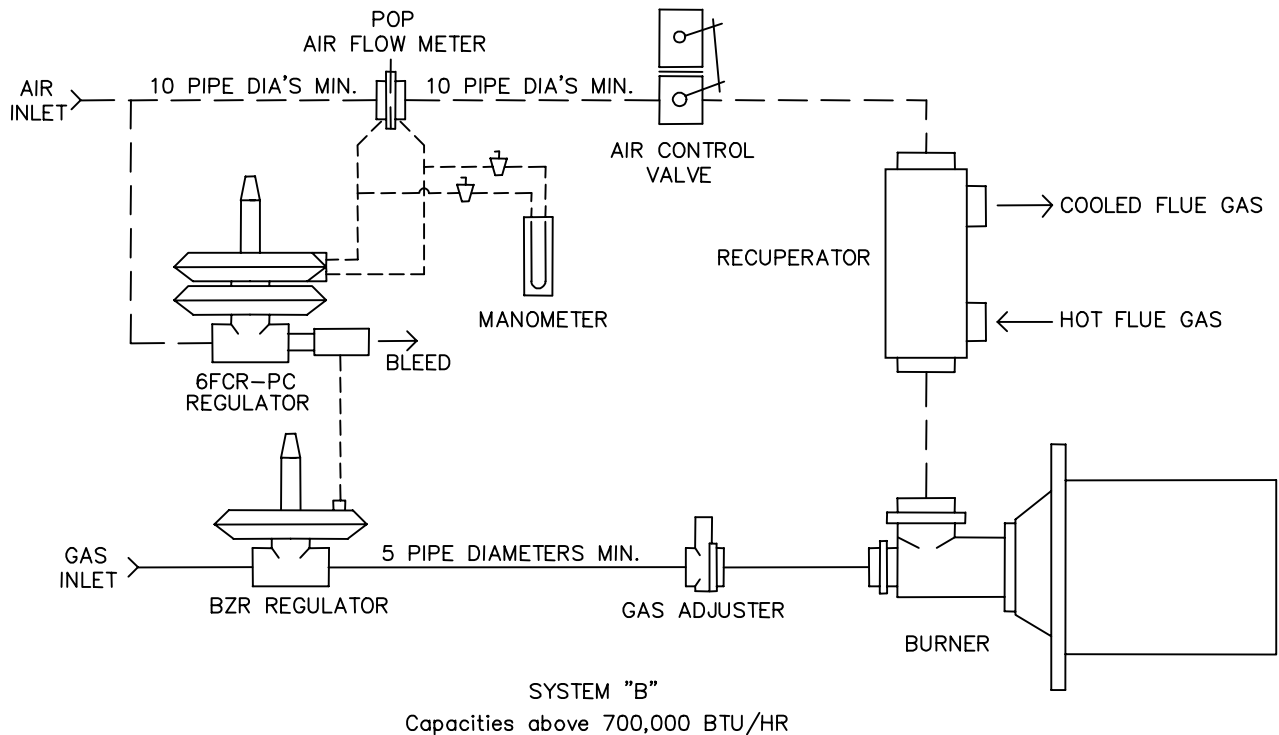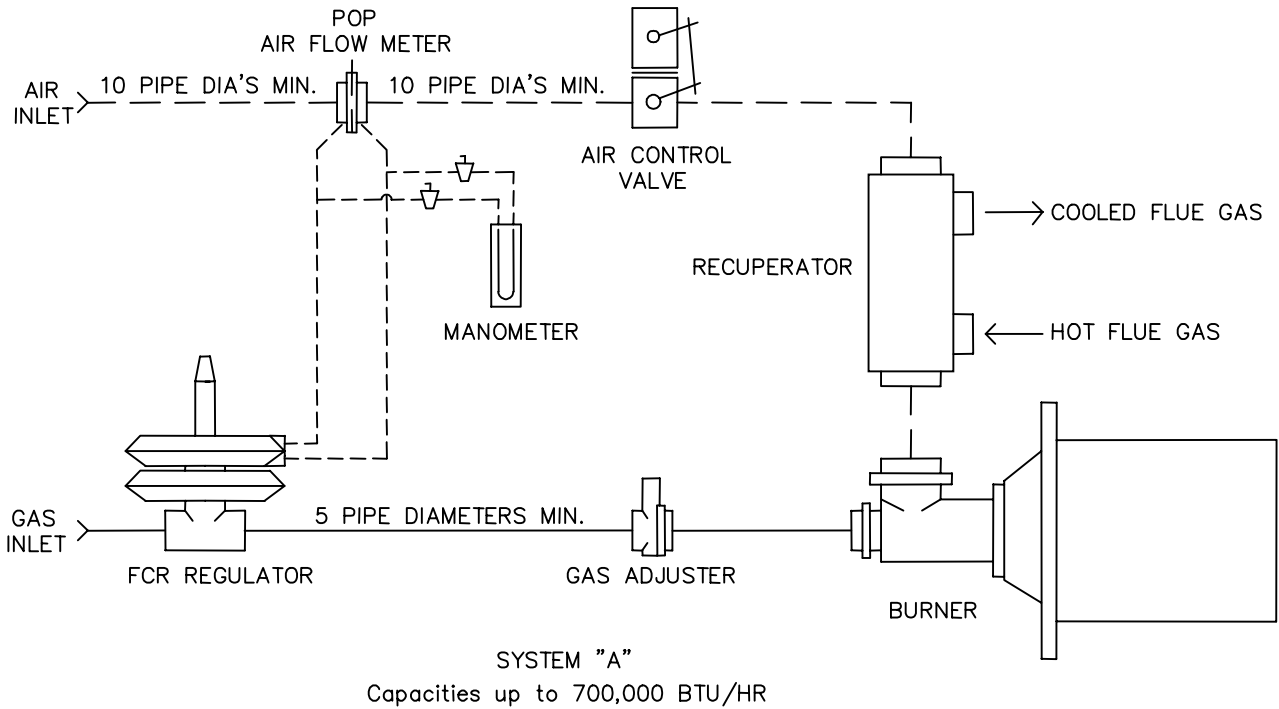

**FOR ADDITIONAL INFORMATION, CONSULT THE FACTORY  
OR YOUR LOCAL PYRONICS REPRESENTATIVE.**

CAUTION: Operation of combustion equipment can be hazardous resulting in bodily injury or equipment damage. Each burner should be supervised by a combustion safeguard and only qualified personnel should install, make system adjustments and perform any required service.



**pyronics inc.**

COMBUSTION FOR INDUSTRY  
17700 MILES ROAD  
CLEVELAND, OH 44128  
www.pyronics.com

Tel: 216-662-8800  
Fax: 216-663-8954  
marketing@pyronics.com

NOTICE: PYRONICS practices a policy of continuous improvement in the design of its products. It reserves the right to change the specifications at any time without prior notice.

# REGULATORS FLOW CONTROL

BULLETIN 5105  
PAGE NO. 4

## SYSTEM COMPONENTS

MAX BTU Rating in Thousands	FCR Regulator	Balanced Zero Regulator	Gas Pipe Size	Recommended Air Orifice Flow Meter	Air Pipe Size
100	6 FCR	<b>Not Required</b>	3/4"	12 POP-07	1-1/2"
200	6 FCR		3/4"	16 POP-09	2"
370	6 FCR		3/4"	20 POP-11	2-1/2"
700	8 FCR		1"	24 POP-13	3"
1,400	6 FCR-PC	5101-12BZR	1-1/2"	32 POP-15	4"
2,700	6 FCR-PC	5101-16BZR	2"	48 POP-17	6"
5,000	6 FCR-PC	5101-20BZR	3"	<b>* As Required</b>	8"
8,000	6 FCR-PC	5101-24BZR	4"		10"
12,000	6 FCR-PC	5101-32BZR	4"		12"
16,000	6 FCR-PC	5101-32BZR	6"		14"

Manometer to have a 12 inch w.c. scale.

Systems are sized using natural gas at 1,000 BTU per cubic foot.

Air orifice flow meter sized for a 10" w.c. drop across plate.

\* Air orifice flanges or pipe taps with standard pipe flanges recommended for systems rated greater than 5,000,000 BTU/Hour.

The load lines connecting the regulators, orifice meter, manometer and shutoff valves should be 1/4" O.D. tubing.

A GAF gas adjuster in main gas line is recommended on multi-burner systems.

When system requirements vary from the BTU values listed above, Pyronics will supply a system tailored to your needs. The air orifice will be sized to match air flow and turn down. The Balanced Zero Regulator will be selected based on BTU, operating fuel/air ratio, gas drop across burner and furnace back pressure.

---

## ORDERING INFORMATION

1. Specify Inlet and Outlet Pressure.
2. Type of Gas, Flow, Specific Gravity and Temperature.
3. Specify Model Number and Quantity.
4. Shipping Instructions.